



Safety Manual SIL 2

Vibration Monitoring Unit Series HE200



MADE IN
GERMANY

SIL 2

PL - d



IECEE



IECEEx



Proc. Cont. Eq.
for Ord. Loc.
Proc. Cont. Eq.
for Haz. Loc.



- ATEX / IECEx Zone 2 / 22 and 1 / 21
- cULus OrdLoc / HazLoc Div 2



Safety manual

Vibration Monitoring Unit Type HE200

Standard and ATEX / IECEx

Version: 2025-04-29

Attention!

Before putting the product into operation, the safety manual must be read and understood.

All rights reserved, including rights to translation.
Subject to modifications.

Please contact the company with any questions:

HAUBER-Elektronik GmbH

Fabrikstraße 6

D-72622 Nürtingen

Germany

Tel.: +49 (0) 7022 / 21750-0

Fax: +49 (0) 7022 / 21750-50

info@hauber-elektronik.de

www.hauber-elektronik.de

1 Contents

1	Contents.....	3
2	Scope of safety manual	4
3	Fields of application	4
4	Abbreviations and terms	5
5	Relevant norms	5
6	Safety requirements.....	6
7	Project planning	7
7.1	Safety functionality	7
7.2	Fail Safe State	7
7.3	Configuration safe state	7
7.4	Description of failure categories	8
8	Fault exclusions	8
9	Overview of application areas.....	9
10	Example labels.....	10
11	Connection	11
12	Assembly and installation	13
13	Functional description	13
13.1	Operating conditions.....	13
13.2	Alarm and limit setting	14
13.3	Limit values and delay times.....	15
14	Behaviour during operation and when errors occur.....	16
15	Self-diagnostic and recurring checks.....	17
16	Service life	17
17	Key indicators related to safety.....	18
18	EU and UK Declaration of Conformity	19

2 Scope of safety manual

This safety manual for the vibration monitoring unit model HE200 applies to variants HE200.00, HE200.02 and HE200.01.

The variants are functionally identical. The HE200.02 and HE200.01 variants also possess certifications and labels which permit use in potentially explosive atmospheres.

3 Fields of application

The HE200 type vibration monitoring unit is used to measure and monitor absolute bearing vibrations in machines in line with DIN ISO 10816. The effective vibration speed value or effective vibration acceleration value is used as the measurement parameter.

The vibration amplitude is then evaluated in two channels independent from each other. If the adjustable vibration threshold value is exceeded, a signal will be sent to the semiconductor switches. These can be used to generate a pre-alarm and a main alarm. The HE200 type also has an analogue current output. This supplies direct current of 4-20 mA proportional to the vibration amplitude.

The semiconductor switches and current output were assessed and factored in when determining the safety functionality, using the key indicators related to safety according to the norms mentioned in the section 5.

4 Abbreviations and terms

SIL	Safety Integrity Level
HFT	Hardware Fault Tolerance
SFF	Safe Failure Fraction
CCF	Common Cause Failures
PFD _{avg}	Average Probability of dangerous Failure on Demand
PFH	Probability of a dangerous Failure per Hour
FMEDA	Failure Mode, Effects and Diagnostics Analysis
λ_{sd}	Rate for safe detected failure
λ_{su}	Rate for safe undetected failure
λ_{dd}	Rate for dangerous detected failure
λ_{du}	Rate for dangerous undetected failure
DC _S	Diagnostics Coverage of safe failures; $DC_S = \lambda_{sd} / (\lambda_{sd} + \lambda_{su})$
DC _D	Diagnostics Coverage of dangerous failures; $DC_D = \lambda_{dd} / (\lambda_{dd} + \lambda_{du})$
FIT	Failure In Time; 1 FIT = 1 failure/10h
MTBF	Mean Time Between Failure
MTTF	Mean Time To Failure
MTTR	Mean Time To Repair
CAT	Category according to EN ISO 13849-1:2008

Tab. 1: Abbreviations and terms

Other abbreviations and terms are defined in the IEC 61508-4.

5 Relevant norms

IEC 61508 Functional safety of electrical/electronic/programmable electronic safety-related systems. (IEC 61508:2010)

ISO 13849-1 Safety of machinery - Safety-related parts of control systems - Part 1: General principles for design (ISO 13849-1:2015); German version EN ISO 13849-1:2016

6 Safety requirements

Safety integrity level	Operating mode with low re-requirement rate	Operating mode with high requirement rate
SIL	PFD _{avg}	PFH
4	$\geq 10^{-5} - < 10^{-4}$	$\geq 10^{-9} - < 10^{-8}$
3	$\geq 10^{-4} - < 10^{-3}$	$\geq 10^{-8} - < 10^{-7}$
2	$\geq 10^{-3} - < 10^{-2}$	$\geq 10^{-7} - < 10^{-6}$
1	$\geq 10^{-2} - < 10^{-1}$	$\geq 10^{-6} - < 10^{-5}$

Tab. 2: Failure threshold values for a safety function, depending on the SIL class (IEC 61508-1, 7.6.2)

Rate of dangerous failures	Fault tolerance of the hardware for type B safety-related sub-systems (IEC 61508-2, 7.4.3)		
SFF	HFT = 0	HFT = 1	HFT = 2
< 60%	Not allowed	SIL1	SIL2
60% – < 90%	SIL1	SIL2	SIL3
90% – < 99%	SIL2	SIL3	SIL4
$\geq 99\%$	SIL3	SIL4	-

Tab. 3: Hardware fault tolerance, based on the rate of dangerous failures

The vibration monitoring unit model HE200 is a development in accordance with IEC-IEC-61508. The monitoring was developed as a "high demand system". It corresponds to a 1oo1 architecture with a diagnostic coverage of > 90%. The diagnostics are permanent and automatic during operation and the start-up phase of monitoring. Monitoring fulfils a Safe Failure Fraction of 90%... <99% and is thus a sensor system in accordance with SIL2.

7 Project planning

7.1 Safety functionality

The system includes 3 safety functions:

1. If the measured vibration value exceeds the threshold value set for the pre-alarm for longer than the set delay period, the pre-alarm relay will open (pin 5 and pin 6).
2. If the measured vibration value exceeds the threshold value set for the main alarm for longer than the set delay period, the main alarm relay will open (pin 7 and pin 8).
3. The analogue current output depicts the vibration value measured in the interval between 4mA and 20mA.

The vibration value is either the vibration speed or the vibration acceleration depending on the sensor version.

NOTE

The next control unit must trigger the shutdown should the current output deliver more than 20 mA.

7.2 Fail Safe State

In the event of a fault that cannot be corrected (e.g. hardware defect, or vibration in resonance with the sensor), the sensor will switch to the fail safe state. This state can only be exited by power cycling. The fail safe state can be recognised when all 3 of the following occur at the same time:

- All status LEDs are switched (red, yellow, green)
- All semiconductor switches are opened. (low level)
- Current output is set to 0mA.

7.3 Configuration safe state

The operator can set the sensor in configuration mode as described in the operating manual. A sensor in configuration mode is not considered to be in a safe state. The safety functions as specified will not operate until configuration has been saved and the sensor is in normal operating mode. The measurement signal is only validated again after leaving the Configuration Safe mode and meets the requirements for the safety function.

7.4 Description of failure categories

The following definitions for failure of the device were considered in order to assess the failure behaviour of the vibration monitoring unit:

- Fail-Safe State
Responds to a failure state by switching to a safe state. (fail safe state)
- Safe Failure ($\lambda_{sd} + \lambda_{su}$)
A safe failure (S) occurs when the measuring system switches to the defined safe state or to error mode without requesting the process.
- Dangerous Failure ($\lambda_{dd} + \lambda_{du}$)
A dangerous failure (D) generally occurs when the measuring system switches to a dangerous or non-functional state.
- Dangerous Detected Failure (λ_{dd})
A dangerous detected failure occurs when the measuring system switches to a defined safe state or to error mode when a process is requested.
- Dangerous Undetected Failure (λ_{du}):
A dangerous undetected failure occurs when the measuring system switches to neither a defined safe state nor to error mode when a process is requested.
- Definition of error mode:
Error mode is the equivalent to alarm operating mode for the semiconductor switches.

8 Fault exclusions

1. According to ISO 13849-2 (Table D.7), the multi-pole plug connection was chosen to exclude a short circuit between any two adjacent plug pins.

9 Overview of application areas

Coding		HE200.00.xx.xx.xx.00.xxx	HE200.00.xx.xx.xx.01.xxx	HE200.02.xx.xx.xx.00.xxx	HE200.02.xx.xx.xx.01.xxx	HE200.01.xx.xx.xx.00.xxx	HE200.01.xx.xx.xx.02.xxx
Connection	M12 connector	x		x			
	Integrated cable		x		x	x	x
Measuring head temperature T_M Ambient temperature T_A	$-40\text{ °C} \leq T_M \leq 85\text{ °C}$ $-40\text{ °C} \leq T_A \leq 60\text{ °C}$	x		x		x	
Restriction for the range of application cULus: $-30\text{ °C} \leq T_M \leq 80\text{ °C}$ $-30\text{ °C} \leq T_A \leq 60\text{ °C}$	$-35\text{ °C} \leq T_M \leq 125\text{ °C}$ $-35\text{ °C} \leq T_A \leq 60\text{ °C}$		x		x		
	$-20\text{ °C} \leq T_M \leq 125\text{ °C}$ $-20\text{ °C} \leq T_A \leq 60\text{ °C}$						x
Standard	   	x	x	x	x	x	x
	 Proc. Cont. Eq. Ord. Loc E507077	x	x	x	x		
Ex Zone 2 and 22	 II 3G Ex ec IIC T4 Gc II 3D Ex tc IIIC 135°C Dc	UL 21 ATEX 2570 X; UL22UKEX2480X			x	x	
	 Ex ec IIC T4 Gc Ex tc IIIC 135°C Dc	IECEx ULD 20.0022 Issue 0X; UL-BR 21.1250X			x	x	
	 Ex ec IIC T4 Gc Ex tc IIIC T135°C DC	23-AV4BO-0275X 23-AV4BO-0276X			x	x	
	 Proc. Cont. Eq. Haz. Loc. Class I, Division 2, Groups A, B, C and D, T4 Class II, Division 2 Groups F and G, T4	E516625			x	x	
	 Ex nA IIC T4 Gc Ex tD A22 IP66/67 T135°C	No: 2021122315114599			x	x	
Ex Zone 1 and 21	 II 2G Ex db IIC T4 Gb II 2D Ex tb IIIC 135°C Db	UL 20 ATEX 2421 X; UL22UKEX2479X					x
	 Ex db IIC T4 Gb Ex tb IIIC 135°C Db	IECEx ULD 20.0022 Issue 0X; UL-BR 21.1250X					x
	 Ex db IIC T4 Gb Ex tb IIIC T135°C Db	23-AV4BO-0277X 23-AV4BO-0278X					x
	 Ex d IIC T4 Gb Ex tD A21 IP66/67 T135°C	No: 2021122315114599					x

10

Example labels

Variant 1 - HE200.00.xx.xx.xx.00.000

HE HAUBER ELEKTRONIK Type: HE2xx.00.xx.xx.xx.00.000 Item-no.: 12345 Serial-no.: 123456 / 2023 Measuring range v_{eff} : 0...xx mm/s Frequency range v_{eff} : xx...xxxx Hz $-40^{\circ}\text{C} \leq T_{amb} \leq +60^{\circ}\text{C}$ Ver.: 1.1	MADE IN GERMANY	IEC	 LISTED E507077 Proc. Cont. Eq. Ord. Loc.	 UK CA	Manufacturer: Hauber-Elektronik GmbH Fabrikstraße 6 72622 Nürtingen Germany www.hauber-elektronik.de
	 SIL2 PL-d	CE	 LISTED E507077 Proc. Cont. Eq. Ord. Loc.	 UK CA	
	 SIL2 PL-d	CE	 LISTED E507077 Proc. Cont. Eq. Ord. Loc.	 UK CA	
	 SIL2 PL-d	CE	 LISTED E507077 Proc. Cont. Eq. Ord. Loc.	 UK CA	

Variant 2 - HE200.00.xx.xx.xx.01.xxx

HE HAUBER ELEKTRONIK Type: HE2xx.00.xx.xx.xx.01.xxx Item-no.: 12345 Serial-no.: 123456 / 2023 Measuring range v_{eff} : 0...xx mm/s Frequency range v_{eff} : xx...xxxx Hz $-35^{\circ}\text{C} \leq T_{amb} \leq +60^{\circ}\text{C}$ Ver.: 1.1	MADE IN GERMANY	IEC	 LISTED E507077 Proc. Cont. Eq. Ord. Loc.	 UK CA	Manufacturer: Hauber-Elektronik GmbH Fabrikstraße 6 72622 Nürtingen Germany www.hauber-elektronik.de
	 SIL2 PL-d	CE	 LISTED E507077 Proc. Cont. Eq. Ord. Loc.	 UK CA	
	 SIL2 PL-d	CE	 LISTED E507077 Proc. Cont. Eq. Ord. Loc.	 UK CA	
	 SIL2 PL-d	CE	 LISTED E507077 Proc. Cont. Eq. Ord. Loc.	 UK CA	

Variant 3 - HE200.02.xx.xx.xx.00.000

HE HAUBER ELEKTRONIK Type: HE2xx.02.xx.xx.xx.00.000 Item-no.: 12345 Serial-no.: 123456 / 2023 Measuring range v_{eff} : 0...xx mm/s Frequency range v_{eff} : xx...xxxx Hz $-40^{\circ}\text{C} \leq T_{amb} \leq +60^{\circ}\text{C}$ Ver.: 1.1	MADE IN GERMANY	IECEx	 LISTED E516625 Proc. Cont. Eq. Haz. Loc.	 UK CA	Manufacturer: Hauber-Elektronik GmbH Fabrikstraße 6 72622 Nürtingen Germany www.hauber-elektronik.de
	 SIL2 PL-d	CE	 LISTED E516625 Proc. Cont. Eq. Haz. Loc.	 UK CA	
	 SIL2 PL-d	CE	 LISTED E516625 Proc. Cont. Eq. Haz. Loc.	 UK CA	
	 SIL2 PL-d	CE	 LISTED E516625 Proc. Cont. Eq. Haz. Loc.	 UK CA	

Variant 4 - HE200.02.xx.xx.xx.01.xxx

HE HAUBER ELEKTRONIK Type: HE2xx.02.xx.xx.xx.01.xxx Item-no.: 12345 Serial-no.: 123456 / 2023 Measuring range v_{eff} : 0...xx mm/s Frequency range v_{eff} : xx...xxxx Hz $-35^{\circ}\text{C} \leq T_{amb} \leq +60^{\circ}\text{C}$ Ver.: 1.1	MADE IN GERMANY	IECEx	 LISTED E516625 Proc. Cont. Eq. Haz. Loc.	 UK CA	Manufacturer: Hauber-Elektronik GmbH Fabrikstraße 6 72622 Nürtingen Germany www.hauber-elektronik.de
	 SIL2 PL-d	CE	 LISTED E516625 Proc. Cont. Eq. Haz. Loc.	 UK CA	
	 SIL2 PL-d	CE	 LISTED E516625 Proc. Cont. Eq. Haz. Loc.	 UK CA	
	 SIL2 PL-d	CE	 LISTED E516625 Proc. Cont. Eq. Haz. Loc.	 UK CA	



Variant 5 - HE200.01.xx.xx.xx.00.xxx

HE HAUBER ELEKTRONIK Type: HE2xx.01.xx.xx.xx.00.xxx Item-no.: 12345 Serial-no.: 123456 / 2023 Measuring range v_{eff} : 0...xx mm/s Frequency range v_{eff} : xx...xxxx Hz $-40^{\circ}\text{C} \leq T_{amb} \leq +60^{\circ}\text{C}$ Ver.: 1.1	MADE IN GERMANY	IECEx	 LISTED E516625 Proc. Cont. Eq. Haz. Loc.	 UK CA	Manufacturer: Hauber-Elektronik GmbH Fabrikstraße 6 72622 Nürtingen Germany www.hauber-elektronik.de
	 SIL2 PL-d	CE	 LISTED E516625 Proc. Cont. Eq. Haz. Loc.	 UK CA	
	 SIL2 PL-d	CE	 LISTED E516625 Proc. Cont. Eq. Haz. Loc.	 UK CA	
	 SIL2 PL-d	CE	 LISTED E516625 Proc. Cont. Eq. Haz. Loc.	 UK CA	

Variant 6 - HE200.01.xx.xx.xx.02.xxx

HE HAUBER ELEKTRONIK Type: HE2xx.01.xx.xx.xx.02.xxx Item-no.: 12345 Serial-no.: 123456 / 2023 Measuring range v_{eff} : 0...xx mm/s Frequency range v_{eff} : xx...xxxx Hz $-20^{\circ}\text{C} \leq T_{amb} \leq +60^{\circ}\text{C}$ Ver.: 1.1	MADE IN GERMANY	IECEx	 LISTED E516625 Proc. Cont. Eq. Haz. Loc.	 UK CA	Manufacturer: Hauber-Elektronik GmbH Fabrikstraße 6 72622 Nürtingen Germany www.hauber-elektronik.de
	 SIL2 PL-d	CE	 LISTED E516625 Proc. Cont. Eq. Haz. Loc.	 UK CA	
	 SIL2 PL-d	CE	 LISTED E516625 Proc. Cont. Eq. Haz. Loc.	 UK CA	
	 SIL2 PL-d	CE	 LISTED E516625 Proc. Cont. Eq. Haz. Loc.	 UK CA	

11 Connection

Version:	M12 connector		
	Pin 1:	24 V DC	
	Pin 2:	GND	
	Pin 3:	4-20 mA output signal	
	Pin 4:	NC (Not connected)	
	Pin 5:	Potential-free semiconductor switch 1 +	
	Pin 6:	Potential-free semiconductor switch 1 -	
	Pin 7:	Potential-free semiconductor switch 2 +	
	Pin 8:	Potential-free semiconductor switch 2 -	
Version:	Integrated cable		
	Pin 1:	white	24 V DC
	Pin 2:	brown	GND
	Pin 3:	green	4-20 mA output signal
	Pin 4:	yellow	NC (Not connected)
	Pin 5:	grey	Potential-free semiconductor switch 1 +
	Pin 6:	pink	Potential-free semiconductor switch 1 -
	Pin 7:	blue	Potential-free semiconductor switch 2 +
	Pin 8:	red	Potential-free semiconductor switch 2 -

Wiring diagram:

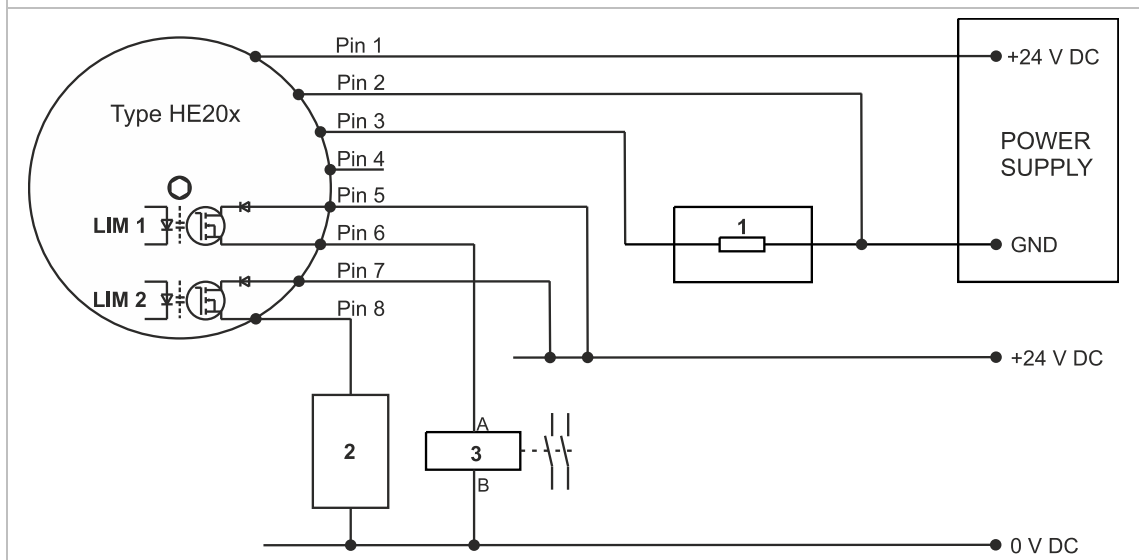


Fig. 1: Wiring diagram

LIM 1 Potential-free semiconductor switch 1 (unidirectional, Pin 5: + , Pin 6: -)

LIM 2 Potential-free semiconductor switch 2 (unidirectional, Pin 7: + , Pin 8: -)

1 Analog Input (4-20mA) of an evaluation unit (e.g. Safety Controller, PLC, ...)

2 Application example: Digital in (I/O) of a safety controller

3 Application example: Safety relay



The potential-free semiconductor switches LIM 1 and LIM 2 are blocked ('opened') when powered off or in alert state



If the current output (4-20mA) is not required, it should be connected to GND

12 Assembly and installation

Pay attention to the assembly and installation notes in the operating manual. To do this, select threshold value settings so that the safety function is triggered before any damage can be done to the system.

The sensor must be powered by a SELV power supply in safe operation.

13 Functional description



In an explosive atmosphere the vibration monitoring unit HE200 will only be opened in a de-energized state.

The HE200 type has two limit values Lim1 and LIM2 and the corresponding delay times, which can be adjusted separately. If the defined limit value is exceeded and after the set delay time has expired, the corresponding potential-free semiconductor switch is opened. This can be used to generate a pre-alarm and a main alarm.

A subsequent fall below the limit value is also signalled at potential-free semiconductor switches 1 and 2, i.e. the respective semiconductor switch automatically closes.

The HE200 type also has an analogue current output. This supplies direct current of 4-20 mA proportional to the vibration amplitude.

13.1 Operating conditions

Operating state	Reading	Semiconductor switches	LED status
OK	$\leq$ Limit value	Closed	green
WARNING	$>$ Limit value, delay time runs	Closed	green + yellow
ALARM	$>$ Limit value, delay time expired	Open	red
Fail Safe State	0 mA	Open	red + yellow + green
De-energized	0 mA	Open	All LEDs off

Tab. 4: Operating conditions

13.2 Alarm and limit setting



While the sensor is in configuration mode, the safety functions are deactivated.

By pressing the "Save Config" button, the current configuration is displayed by the LEDs around the HEX switches.

The limit values and delay times are calibrated using the respective HEX switch. As soon as a switch position is changed, all LEDs start flashing. Press and hold the "Save Config" button for three seconds to save the configuration. Acceptance of the configuration is signalled by steady lighting up of the LEDs in the selected HEX switch position.

The configuration can only be accepted if $LIM1 \leq LIM2$.

After about five minutes the LEDs turn off automatically.

13.3 Limit values and delay times

The **SET rotary button** has 16 positions, representing the limit value of an alarm. The measuring range of the vibration monitoring unit is divided into 16 linear steps.

$$\text{In general: } \text{Limit value} = \frac{\text{Upper limit measuring range}}{16} \times \text{SET rotary button position}$$

Example: Limit setting

Measuring range: 0-32 mm/s

SET rotary button Pos.: 8 (9)

Limit value: 16 mm/s (18 mm/s)

SET- Position ↓	Limit values (mm/s)								
Measu- ring range →	0 – 8 mm/s	0 – 10 mm/s	0 – 16 mm/s	0 – 20 mm/s	0 – 25 mm/s	0 – 32 mm/s	0 – 50 mm/s	0 – 64 mm/s	0 – 128 mm/s
0	0.0	0	0	0	0	0	0.00	0	0
1	0.5	0.625	1	1.25	1.563	2	3.13	4	8
2	1.0	1.25	2	2.5	3.125	4	6.25	8	16
3	1.5	1.875	3	3.75	4.688	6	9.38	12	24
4	2.0	2.5	4	5	6.25	8	12.50	16	32
5	2.5	3.125	5	6.25	7.813	10	15.63	20	40
6	3.0	3.75	6	7.5	9.375	12	18.75	24	48
7	3.5	4.375	7	8.75	10.938	14	21.88	28	56
8	4.0	5	8	10	12.5	16	25.00	32	64
9	4.5	5.625	9	11.25	14.063	18	28.13	36	72
10	5.0	6.25	10	12.5	15.625	20	31.25	40	80
11	5.5	6.875	11	13.75	17.188	22	34.38	44	88
12	6.0	7.5	12	15	18.75	24	37.50	48	96
13	6.5	8.125	13	16.25	20.313	26	40.63	52	104
14	7.0	8.75	14	17.5	21.875	28	43.75	56	112
15	7.5	9.375	15	18.75	23.438	30	46.88	60	120

Tab. 5: Limit values for vibration velocities

SET- Position ↓	Limit values (g)					
Measu- ring range →	0-1 g	0-2 g	0-4 g	0-6 g	0-8 g	0-10 g
0	0	0	0	0	0	0
1	0.063	0.125	0.25	0.375	0.5	0.625
2	0.125	0.25	0.5	0.75	1	1.25
3	0.188	0.375	0.75	1.125	1.5	1.875
4	0.25	0.5	1	1.5	2	2.5
5	0.313	0.625	1.25	1.875	2.5	3.125
6	0.375	0.75	1.5	2.25	3	3.75
7	0.438	0.875	1.75	2.625	3.5	4.375
8	0.5	1	2	3	4	5
9	0.563	1.125	2.25	3.375	4.5	5.625
10	0.625	1.25	2.5	3.75	5	6.25
11	0.688	1.375	2.75	4.125	5.5	6.875
12	0.75	1.5	3	4.5	6	7.5
13	0.813	1.625	3.25	4.875	6.5	8.125
14	0.875	1.75	3.5	5.25	7	8.75
15	0.938	1.875	3.75	5.625	7.5	9.375

Tab. 6: Vibration acceleration limit values

Delay times

TIME Position	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
Delay time (secs)	0	1	2	3	4	5	7.5	10	12.5	15	17.5	20	25	30	45	60

Tab. 7: Delay times

14 Behaviour during operation and when errors occur

The set elements and/or device parameters should not be changed during operation. If set elements and/or device parameters are changed during operation, the operator must ensure the safety of the system! Occurring errors are described in the fault table in the operating manual. If errors are detected, the entire vibration monitoring unit must be taken out of operation and other measures must be taken to keep the process in a safe state. The operating manual describes how to replace the vibration monitoring unit.

15 Self-diagnostic and recurring checks

The sensor has a set of self-diagnostic measures. These are divided into 2 categories:

1. Start-up diagnostic:

These tests are only run in the sensor's initial start-up phase. Among other things, hardware-critical pathways are tested here that cannot be switched off once the device is in operation. One of these critical tests is the diagnostic for the pre-alarm and main alarm switching outputs. In order to ensure the functionality of the switching outputs over the product's service life, the system operator must make sure to cycle the power on the vibration monitoring unit once a year.

2. Cyclical monitoring:

Cyclical monitoring is fully automated and ensures that all tests are performed and evaluated within 12 hours for a diagnostic coverage of > 90%.

16 Service life

The measuring system has a service life of 10 years.

17 Key indicators related to safety

Failure category	Failure rate (FIT)
$\Sigma\lambda$ Safe / Fail Safe Detected (λ_{SD})	600
$\Sigma\lambda$ Dangerous / Fail Dangerous Detected (λ_{DD})	350
$\Sigma\lambda$ no part	80
$\Sigma\lambda$ Total	1030
$\Sigma\lambda$ Dangerous Detected / Fail Dangerous Detected (λ_{DD})	350
$\Sigma\lambda$ Dangerous Undetected / Fail Dangerous Undetected (λ_{DU})	15

SFF (Type B) SF	93.24%
SIL	2
Performance Level	D
Category	2
PFD	$9.2463 \cdot 10^{-4}$
PFH	$< 2 \cdot 10^{-7}$ 1/h With an average expected requirement rate of fewer than 25 times per year
Diagnostic Coverage	>90%

Tab. 8: Failure rates

MTTF	984898hrs = 112.43 years
DC_{avg}	>90% Diagnostic Coverage
$MTTF_d$	2889526hrs = 329.85 years = HIGH
CCF	95 (fulfilled)
Response time	200 ms

Tab. 9: Key indicators related to safety according to ISO 13849-1

18 EU and UK Declaration of Conformity

Declaration of conformity

HAUBER-Elektronik GmbH
Fabrikstraße 6
D-72622 Nürtingen

declares under our sole responsibility that the products listed below that relate to this declaration meet the basic health and safety requirements of the norms and directives below.

Product series

HE200, HE205

ATEX Annex

UL International Demko A/S certifies as **Notified Body No. 0539** according to the Directive of the Council of the European Community of 26 February 2014 (2014/34/EU) that the manufacturer maintains a quality assurance system for production that complies with **Annex IV** of this Directive.

UKEx Annex

UL International Demko A/S certifies as **Notified Body No. 0843** according to the UK Legislative Decree 2016:1107 of December 8, 2016, that the manufacturer maintains a production quality system that complies with **Annex IV** of this Legislative Decree.

Affixed CE and UKCA marking

CE 0539 UK 0843

Norms and directives

EU Directive	Norms
2014/30/EU / UKSI 2016:1091	EN 61000-6-3:2007 + A1:2011 EN 61000-6-2:2005 + AC:2005-09 EN 55011:2016 + A1:2017 + A11:2020 <i>Supplementary:</i> EN 61000-6-7:2015
2014/34/EU / UKSI 2016:1107	EN IEC 60079-0:2018 + AC:2020-02 EN 60079-1:2014 + AC:2018-09 EN IEC 60079-7:2015 + A1:2018 EN 60079-31:2014
2011/65/EU / UKSI 2012:3032	EN IEC 63000:2018

Marking and certificates

HE200.02 / HE205.02

Marking	Certificate
 II 3G Ex ec IIC T4 Gc  II 3D Ex tc IIIC 135°C Dc	ATEX: UL 21 ATEX 2570 X UKEx: UL22UKEX2480X

HE200.01 / HE205.01

Marking	Certificate
 II 2G Ex db IIC T4 Gb  II 2D Ex tb IIIC 135°C Db	ATEX: UL 20 ATEX 2421 X Rev. 0 UKEx: UL22UKEX2479X

Signature

Nürtingen, 29/04/2025

Place and date



Tobias Bronkal, Managing Owner

